


DATE: 9/25/07


REDUNDANCY CIRCUITRY

FOR ALL GENERAL ELEVATOR CORP. HARDWIRE RELAY SYSTEM.

TYPICAL GENERAL ELEVATOR CORP. CONTROL CIRCUITRY.

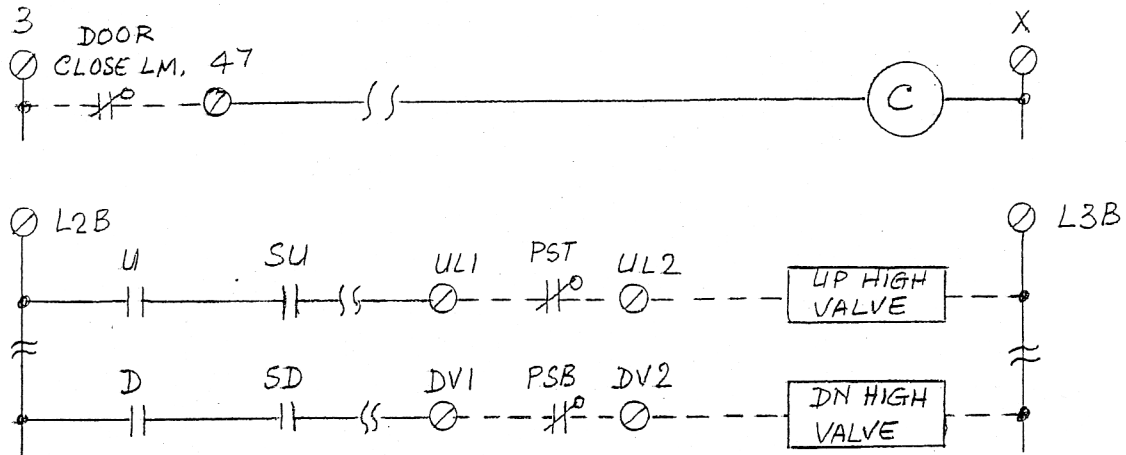

MODIFIED CIRCUITRY

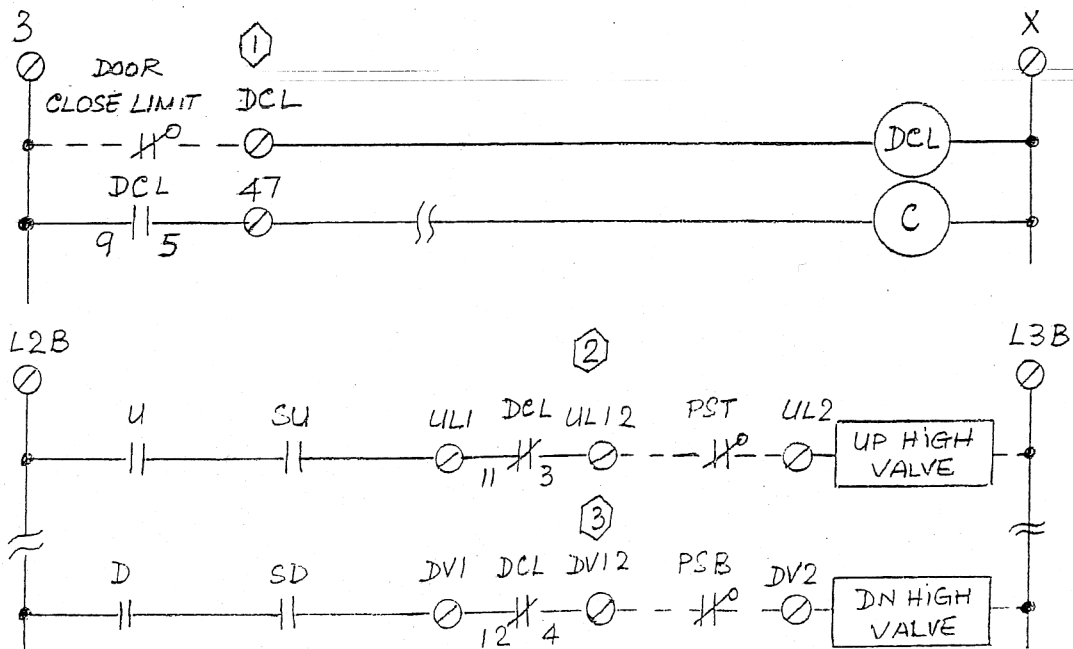

- ① REMOVE FIELD WIRE FROM TERMINAL 47 TO DCL AND INSTALL NEW RELAY AND CONTACT AS ABOVE.
- ② REMOVE THE TOP SLOW DOWN CONTACT FROM TERMINAL UL1 TO NEW TERMINAL UL12, AND INSTALL NEW DCL CONTACT AS ABOVE.
- ③ REMOVE THE BOTTOM SLOW DOWN CONTACT FROM TERMINAL DV1 TO NEW TERMINAL DV12, AND INSTALL NEW DCL CONTACT AS ABOVE.